



# M/s. MAA SANTOSHI CONSTRUCTION & ERECTORS

**GOVT. APPROVED ELECTRICAL CONTRACTORS**

**Specialist in : H.T. & L.T. Line Construction, Industrial Wiring, Repair & Maintenance of Electrical Equipments, Fabrication & Erection of Lighting Tower.**

Ref. No. ....

Date .....

To

The Managing Director,  
Odisha Knowledge Corporation Ltd.,  
Bhubaneswar.

**Subject: Verification report of ICT lab**

Dear Sir,

We are a registered contractor with Name as M/S. Maa Santoshi construction & Erectors, an approved Electrical contractor of Government of Odisha, bearing Licence No. 1926 (HT) (Copy of license is enclosed) for your kind perusal.

After verification of the following items of the ICT lab at GOVT. SSD HIGH SCHOOL, Gorakhpur UDice Code: 21270614502, Block/NAC/Municipality Kasipur, District Rayagada as per the minimum specification mentioned below, the report for the same is being attached.

<b>Sr. No.</b>	<b>Item name</b>	<b>Minimum Specifications</b>	<b>Quantity</b>
1	Earthing (as per IS specifications)	Copper plate earthing stations making earthing with copper earth plate	1
		600 mm x 600 mm x 3 mm thick including funnel, charcoal/coke, salt, all earth work.	
2	Switches and sockets (ISI Mark)	5 A- 240 V switches	15
		2 in 1 5A and 15A Sockets	15
		15 A – 240 V socket with shutter	2


		Indicative Brands: - Anchor / Havells / crabtree / Wipro / Phillips / Legrand (Pls. tick) Switches and sockets is to be provided for all electronics/IT equipment including printer and Projection System to be placed at lab technician table.	
3	Wiring (ISI Mark)	PVC conduits including MS/GI boxes. All wires should be covered, insulated and properly clamped. Wiring for 5 and 15A power outlets with 4 square mm PVC insulated stranded copper conductor wires Earthing of 3rd pin with PVC insulated green color 2.5 square mm copper wire	Full Lab

Findings: (1) Earthing (as per IS specifications): All OK, measuring: 2 Ohms approximately. (2) Switches and sockets (ISI Mark): Anchor, 5, A-240 V switches: Qty.:23, 2 in 1 5A Sockets: Qty.: 19, 15 A – 240 V socket without shutter: 01,(3) Wiring (ISI Mark) PVC conduits including MS/GI boxes: All OK, All wires covered, insulated and properly clamped. Wiring for 5 and 15A power outlets: with 2.5 square mm and PVC insulated trended copper conductor wires, Earthing of 3rd pin: with PVC insulated green colour 1.5 square mm copper wire.


With regards

*Krushna Ch Ret*  
*K-C Ret*  
Name & Signature with seal  
M/s Maa Santoshi  
Construction & Erectors  
Electrical Contractor



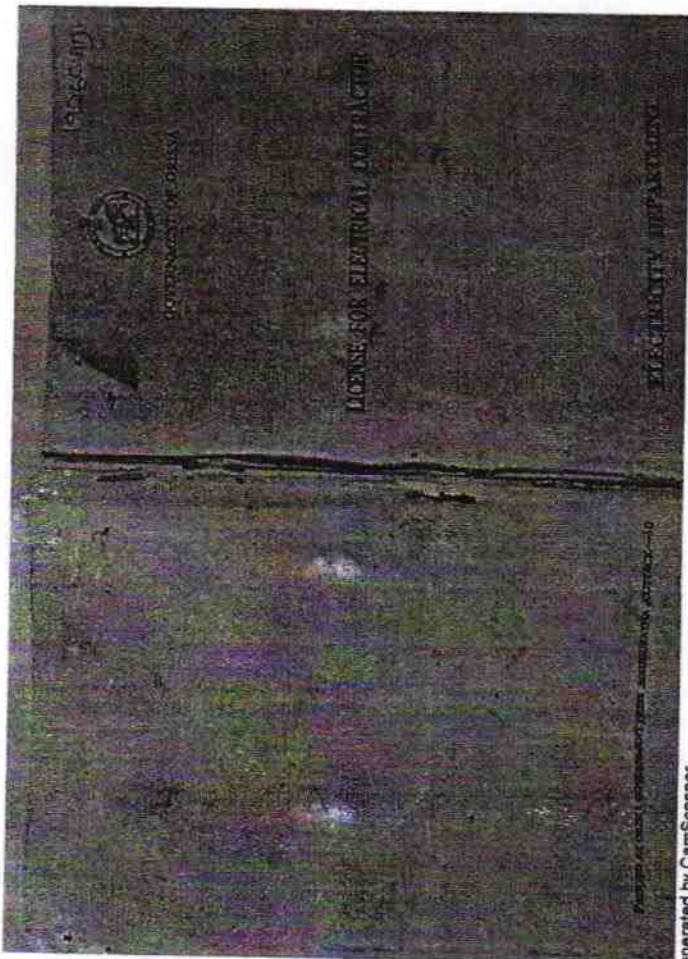

Generated by CamScanner

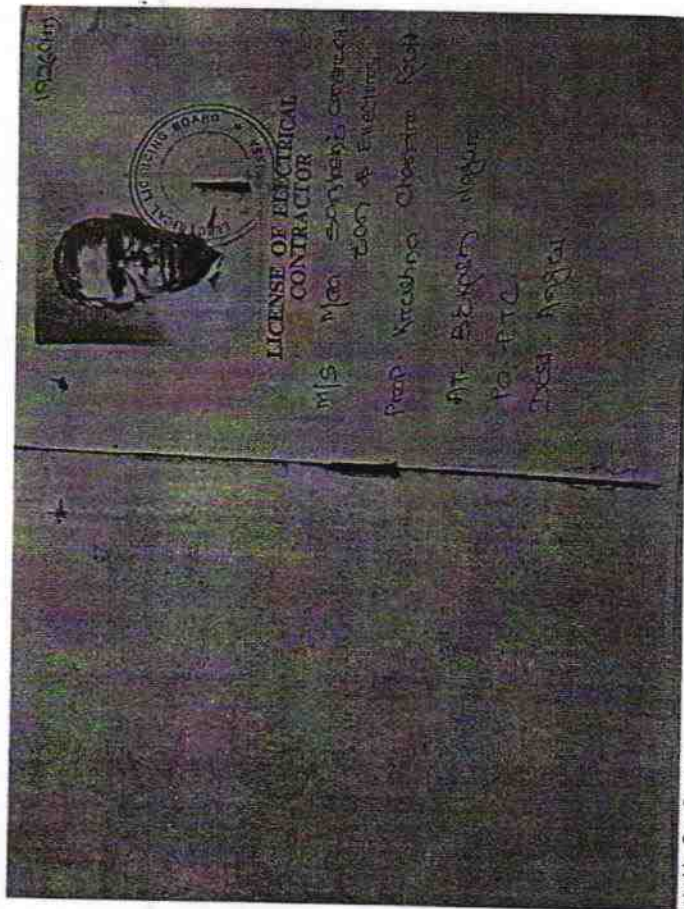

Generated by CamScanner

**FORM 'D'**  
( Regulation 28 )


**ELECTRICAL CONTRACTOR'S LICENSE**

This license is to be renewed for a period of three years at a time and must be produced on demand by the Secretary.





(Not transferable or renewable by any authority other than the Electrical Licensing Board of Orissa).

I do hereby certify that Messrs/Shri. M/s. Man Santoshi (Pvt) Ltd. have this day been granted license to carry out electrical installation work of the following class/classes in the State of Orissa for the purpose of rule 45 (I) of Indian Electricity Rules 1956.

Name and address of the person/firm to whom license is issued.	M/s Mpa Santoshi Carriers & Erectors. Prop. Kreshan Charman Nagor. At. Bhubaneswar Nagar, P.O. P.T.C. Sec. Nagar, Bhubaneswar.
Date of approval by Electrical Licensing Board, Orissa	To be renewed.
Date of issue of license	27.12.2008
Type of electrical installation work for which license is issued.	Allowed to execute electrical installations for HT working upto 11KV (Contractor Class License)
Registration No.	1926 HT

  
 Electrical Inspector to the  
 Government of Orissa and Secretary,  
 Electrical Licensing Board, Orissa

Generated by CamScanner

Date of renewal	Date of expiry	Signature of Electrical Inspector and Secretary, Electrical Licensing Board, Orissa
1	2	3
PROVISIONALLY ALLOWED FOR 1 YEAR I.e. FROM 26.12.2008 TO 25.12.2009. SUBJECT TO REAFFIRMATION BY ELBO.		
 SECRETARY ELBOA		
01- B. Pat 02- B. Barik 03- S. Khuntia 04- N. C. Saha 05- S. K. Bhanja 06- I. Kar		
Working upto 11KV HT upto 11KV HT upto 16KV HT upto 16KV HT upto 22KV HT upto 22KV		
 SECRETARY ELBOA		
Ratified in 127th meeting of ELBO held on 29.4.2009.		
26.12.2009	25.12.2012	 SECRETARY ELBOA
Present status		
1. B. Pat SLE CHD No-4847	03.08.2014	
2. B. Barik WMB No- KNP-580	11.8.2015	
3. S. Khuntia WMB No- AHL-80	27.3.2015	
4. N. C. Saha WMB No- AHL-1676	12.5.2015	
5. S. K. Bhanja WMB No- AHL-1687	12.5.2015	
6. I. Kar WMB No- AHL-112	27.3.2016	 SECRETARY ELBOA

Generated by CamScanner



Date of renewal	Date of expiry	Signature of Electrical Inspector and Secretary, Electrical Licensing Board, byiss
1 6/2/2012 - 25/12/2011 N.B. This License will become invalid if Family Certificate of any of the above staff becomes invalid [Signature]	2 [Signature]	3 [Signature] SECRETARY E L B O