



M/s. MAA SANTOSHI CONSTRUCTION & ERECTORS

GOVT. APPROVED ELECTRICAL CONTRACTORS

Specialist In : H.T. & L.T. Line Construction, Industrial Wiring, Repair & Maintenance of Electrical Equipments, Fabrication & Erection of Lighting Tower.

Ref. No.

Date

To

The Managing Director,
Odisha Knowledge Corporation Ltd.,
Bhubaneswar.

Subject: Verification report of ICT lab

Dear Sir,

We are a registered contractor with Name as M/S. Maa Santoshi construction & Erectors, an approved Electrical contractor of Government of Odisha, bearing Licence No. 1926 (HT) (Copy of license is enclosed) for your kind perusal.

After verification of the following items of the ICT lab at Govt.(SSD) Girls HIGH SCHOOL, Robadi , UDice Code: 21270702501, Block/NAC/Municipality Kolnara, District Rayagada as per the minimum specification mentioned below, the report for the same is being attached.

Sr. No.	Item name	Minimum Specifications	Quantity
1	Earthing (as per IS specifications)	Copper plate earthing stations making earthing with copper earth plate	1
		600 mm x 600 mm x 3 mm thick including funnel, charcoal/coke, salt, all earth work.	
2	Switches and sockets (ISI Mark)	5 A- 240 V switches	15
		2 in 1 5A and 15A Sockets	15
		15 A – 240 V socket with shutter	2

		Indicative Brands: - Anchor / Havells / Crabtree / Wipro / Phillips / Legrand (Pls. tick) Switches and sockets is to be provided for all electronics/IT equipment including printer and Projection System to be placed at lab technician table.	
3	Wiring (ISI Mark)	PVC conduits including MS/GI boxes. All wires should be covered, insulated and properly clamped. Wiring for 5 and 15A power outlets with 4 square mm PVC insulated stranded copper conductor wires Earthing of 3rd pin with PVC insulated green color 2.5 square mm copper wire	Full Lab

Findings: (1) Earthing (as per IS specifications): All OK, measuring: 2 Ohms approximately. (2) Switches and sockets (ISI Mark): Anchor, 5, A- 240 V switches: Qty.:23, 2 in 1 5A Sockets: Qty.: 19, 15 A – 240 V socket without shutter: 01,(3) Wiring (ISI Mark) PVC conduits including MS/GI boxes: All OK, All wires covered, insulated and properly clamped. Wiring for 5 and 15A power outlets: with 2.5 square mm and PVC insulated trended copper conductor wires, Earthing of 3rd pin: with PVC insulated green colour 1.5 square mm copper wire.

With regards

Krushna Ch Raut


K.C.R.

Name & Signature with seal

M/s Maa Santoshi
Construction & Erectors
Electrical Contractor

Encl.

1. Verification report for the given items
2. Electrical contractor's licence copy

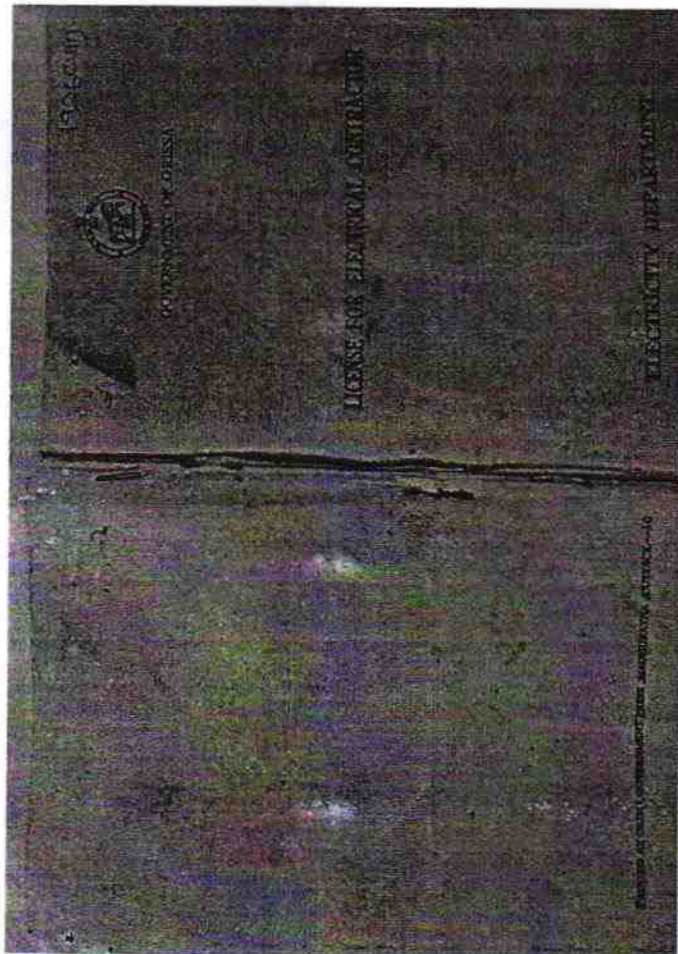

Generated by CamScanner



Generated by CamScanner

FORM 'D'
(Regulation 28)

ELECTRICAL CONTRACTOR'S LICENSE

This license is to be renewed for a period of three years at a time and must be produced on demand by the Secretary.

(Not transferable or renewable by any authority other than the Electrical Licensing Board of Orissa)

I do hereby certify that Messers/Shri. M/S MPA Sankhya Convent have this day been granted license to carry out electrical installation work of the following class/classes in the State of Orissa for the purpose of rule 45 (1) of Indian Electricity Rules 1956.

Name and address of the person/firm to whom license is issued: M/S MPA Sankhya Convent, Prop. Krishna Chandra Nayak, At. Bhubaneswar, Dist. Angul.

Date of approval by Electrical Licensing Board, Orissa: To be renewed.

Date of issue of license: 27.12.2008

Type of electrical installation work for which license is issued: Allowed to execute electrical installations in HT works upto 11KV capacity (Cable Trenching)

Registration No. 1926 HT

[Signature]
Electrical Inspector to the Government of Orissa and Secretary, Electrical Licensing Board, Orissa

Generated by CamScanner

Date of renewal	Date of expiry	Signature of Electrical Inspector and Secretary, Electrical Licensing Board, Orissa
1	2	3
PROVISIONALLY ALLOWED FOR 1 YEAR I.e. FROM 26.12.2008 TO 25.12.2009. SUBJECT TO REGISTRATION BY ELBOA.		
<i>[Signature]</i> SECRETARY ELBOA		
01. B. Pat SLE CHD No-4847 02. B. Barik WMB No- KNP-580 03. S. Khuntia WMB No- AHL-170 04. N. C. Sahu WMB No- AHL-1676 05. S. K. Bhanja WMB No- AHL-1671 06. I. Kar WMB No- AHL-412		
Ratified in 127th meeting of A-132 held on 29.4.2009.		
26.12.2009	25.12.2012	<i>[Signature]</i> SECRETARY ELBOA
Present 5 tabs		
1. B. Pat SLE CHD No-4847	03.08.2014	<i>[Signature]</i> SECRETARY ELBOA
2. B. Barik WMB No- KNP-580	11.8.2014	
3. S. Khuntia WMB No- AHL-170	27.3.2015	
4. N. C. Sahu WMB No- AHL-1676	12.5.2015	
5. S. K. Bhanja WMB No- AHL-1671	12.5.2015	
6. I. Kar WMB No- AHL-412	27.3.2016	

Generated by CamScanner

Date of renewal	Date of expiry	Signature of Electrical Inspector and Secretary, Electrical Licensing Board, orissa.
1 6-12-2012 N.B. - This License will become invalid if Permit/Certificate of any of the above staff becomes invalid SECRETARY E L B O Dist.	2 25-12-2015 SECRETARY E L B O Dist.	3 SECRETARY E L B O Dist.