



# M/s. MAA SANTOSHI CONSTRUCTION & ERECTORS

**GOVT. APPROVED ELECTRICAL CONTRACTORS**

**Specialist in : H.T. & L.T. Line Construction, Industrial Wiring, Repair & Maintenance of Electrical Equipments, Fabrication & Erection of Lighting Tower.**

Ref. No. ....

Date .....

To

The Managing Director,  
Odisha Knowledge Corporation Ltd.,  
Bhubaneswar.

**Subject: Verification report of ICT lab**

Dear Sir,

We are a registered contractor with Name as M/S. Maa Santoshi construction & Erectors, an approved Electrical contractor of Government of Odisha, bearing Licence No. 1926 (HT) (Copy of license is enclosed) for your kind perusal.

After verification of the following items of the ICT lab at GOVT. (SSD) HIGH SCHOOL, Bileshu, UDice Code: 21271106502, Block/NAC/Municipality Rayagada, District Rayagada as per the minimum specification mentioned below, the report for the same is being attached.

<b>Sr. No.</b>	<b>Item name</b>	<b>Minimum Specifications</b>	<b>Quantity</b>
1	Earthing (as per IS specifications)	Copper plate earthing stations making earthing with copper earth plate	1
		600 mm x 600 mm x 3 mm thick including funnel, charcoal/coke, salt, all earth work.	
2	Switches and sockets (ISI Mark)	5 A- 240 V switches	15
		2 in 1 5A and 15A Sockets	15
		15 A – 240 V socket with shutter	2

		Indicative Brands: - Anchor / Havells / crabtree / Wipro / Phillips / Legrand (Pls. tick) Switches and sockets is to be provided for all electronics/IT equipment including printer and Projection System to be placed at lab technician table.	
3	Wiring (ISI Mark)	PVC conduits including MS/GI boxes. All wires should be covered, insulated and properly clamped. Wiring for 5 and 15A power outlets with 4 square mm PVC insulated stranded copper conductor wires Earthing of 3rd pin with PVC insulated green color 2.5 square mm copper wire	Full Lab

**Findings:**

1. Earthing (as per IS specifications) :	All OK	2 Ohms		
2. Switches and sockets (ISI Mark) :		Status	Qty.	Brand
5 A- 240 V switches :	OK		23	Anchor
2 in 1 5A and 15A Sockets:	OK		19	Anchor
15 A – 240 V socket without shutter:	OK		01	Anchor

3. Wiring (ISI Mark)  
PVC conduits including MS/GI boxes. **All OK**  
All wires covered, insulated and properly  
Clamped.

Wiring for 5 and 15A power outlets:

with 2.5 square mm PVC insulated trended copper  
conductor wires

Earthing of 3rd pin:

with PVC insulated green colour 1.5  
square mm copper wire

*Krishna Ch Rao*

With regards

*K.C Rao*


Name & Signature with seal

M/s Maa Santosh  
Construction & Erectors  
Electrical Contractor


Encl.

1. Verification report for the given items
2. Electrical contractor's licence copy



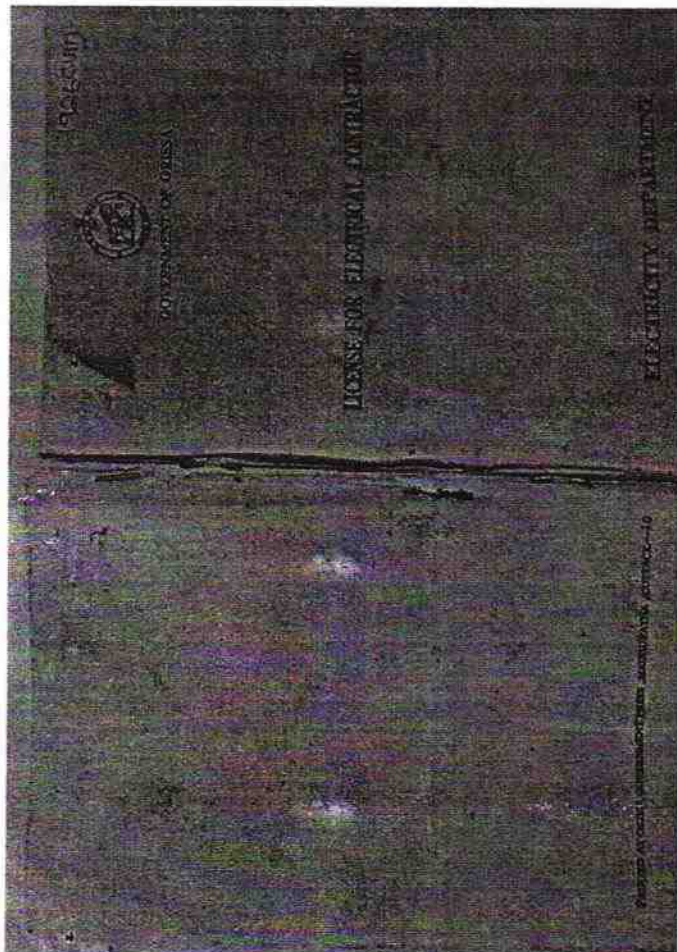

Generated by CamScanner

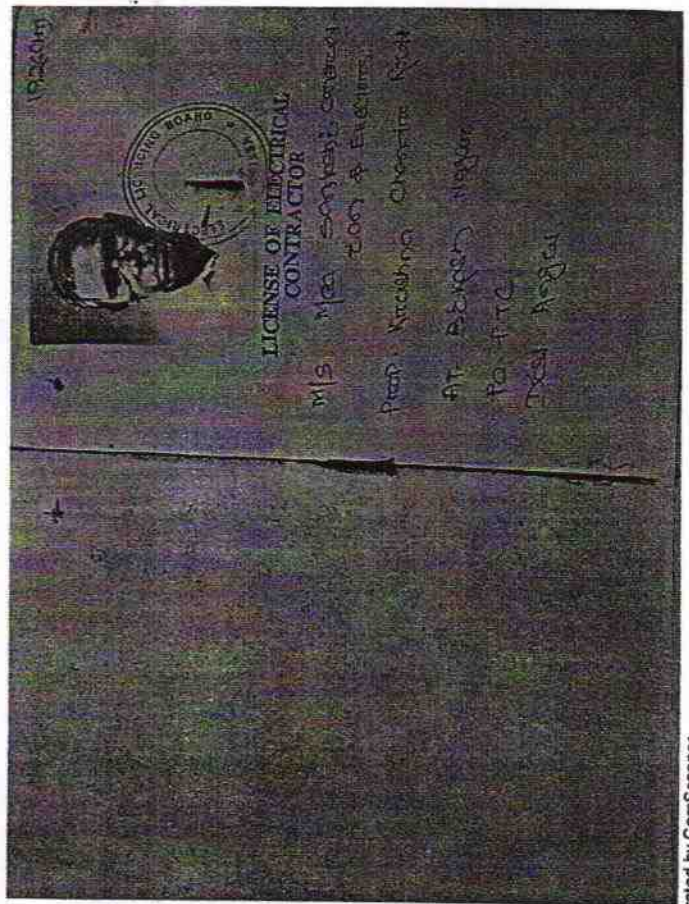

Generated by CamScanner

**FORM 'D'**  
(Regulation 28)

**ELECTRICAL CONTRACTOR'S LICENSE**

This license is to be renewed for a period of three years at a time and must be produced on demand by the Secretary.

(Not transferable or renewable by any authority other than the Electrical Licensing Board of Orissa)

I do hereby certify that Messers/Shri. Mpa Sanyasho (Contractors & Erectors) have this day been granted license to carry out electrical installation work of the following class/classes in the State of Orissa for the purpose of rule 45 (1) of Indian Electricity Rules 1956.

Name and address of the person/firm to whom license is issued: M/S Mpa Sanyasho Contractor & Erectors, Prof. Krishna Chandra Nayak, At Bargaraj Nagar, P.O. PTC, Dist. Angul.

Date of approval by Electrical Licensing Board, Orissa: To be re-issued.

Date of issue of license: 27.12.2008

Type of electrical installation work for which license is issued: Allowed to execute electrical installations for HT works upto 11KV Chemostat Cable Joints etc.

Registration No. 1926 (HT)

*(Signature)*  
Electrical Inspector to the Government of Orissa and Secretary, Electrical Licensing Board, Orissa

Generated by CamScanner

Date of renewal	Date of expiry	Signature of Electrical Inspector and Secretary, Electrical Licensing Board, Orissa
1 PROVISIONALLY ALLOWED FOR 1 YEAR i.e. FROM <u>26.12.2008</u> TO <u>25.12.2009</u> . SUBJECT TO REGISTRATION BY E.L.B.O.	2	3
<p><i>(Signature)</i> SECRETARY E.L.B.O.</p> <p>01. B. Pat 02. B. Barik 03. S. Khuntia 04. N. C. Saha 05. S. K. Bhanja 06. I. Kar</p> <p>Dist. - ANUG, O.E., 1000V, O. 2000V P.O. - 15520, C.E. - 0100</p>	<p><i>(Signature)</i> SECRETARY E.L.B.O.</p>	<p><i>(Signature)</i> SECRETARY E.L.B.O.</p>
<p>Ratified in 127th meeting of R.130 held on 29.4.2009.</p> <p>26.12.2009</p> <p>Present status</p>	<p>25.12.2012</p> <p>Validity</p>	<p><i>(Signature)</i> SECRETARY E.L.B.O.</p>
<p>1. B. Pat SLE CHDNO-4847</p> <p>2. B. Barik WMBNO-KNP580</p> <p>3. S. Khuntia WMBNO-AHL-120</p> <p>4. N. C. Saha WMBNO-AHL-1676</p> <p>5. S. K. Bhanja WMBNO-AHL-1681</p> <p>6. I. Kar WMBNO-AHL-112</p>	<p>03.08.2014</p> <p>11.8.2015</p> <p>27.3.2015</p> <p>12.5.2015</p> <p>12.5.2015</p> <p>27.3.2016</p>	<p><i>(Signature)</i> SECRETARY E.L.B.O.</p>

Generated by CamScanner



Date of renewal	Date of expiry	Signature of Electrical Inspector and Secretary, Electrical Licensing Board, orissa
1 6/2/2012 - 25/12/2011 - N.B - This License will become Invalid if Permit/Certificate of any of the above staff becomes invalid SECRETARY ELBO [Signature]	2 [Signature]	3 SECRETARY ELBO [Signature]